


|  |                                       |
|--|---------------------------------------|
| JOB NAME:<br>REAR RAIL,<br>IN LINE OPENING | DRAWING NUMBER:<br>REMI-3<br>15 SQ FT |
|--|---------------------------------------|

**NOTES:**

- Ⓐ 1/4" THICK MAXIMUM TRIM TO BE INSTALLED ON BACKSIDE OF LANDING DOOR FRAMES
- Ⓑ LANDING DOORS TO BE SOLID CORE (BY OTHERS)
- Ⓒ ALL LANDING DOORS AND JAMB/FRAMES ARE TO BE INSTALLED IN A 2" X 4" WALL CONSTRUCTION (OR EQUIVALENT) OR RECESSED TO THE SHAFT SIDE OF THE WALL IN A LARGER WALL CONSTRUCTION. THIS IS MANDATORY TO COMPLY WITH THE 3" X 5" RULE, PER ANSI A17.1; PART 5.3 PRIVATE RESIDENCE ELEVATORS (RULE 5.3.1.4.2). IF CONSTRUCTION OF THE LANDING DOOR WALL(S) IS GREATER THAN 2" X 4" CONSTRUCTION CONSULT WITH ELEVATOR MANUFACTURER PRIOR TO FRAMING AND INSTALLATION OF DOOR JAMB/FRAMES.

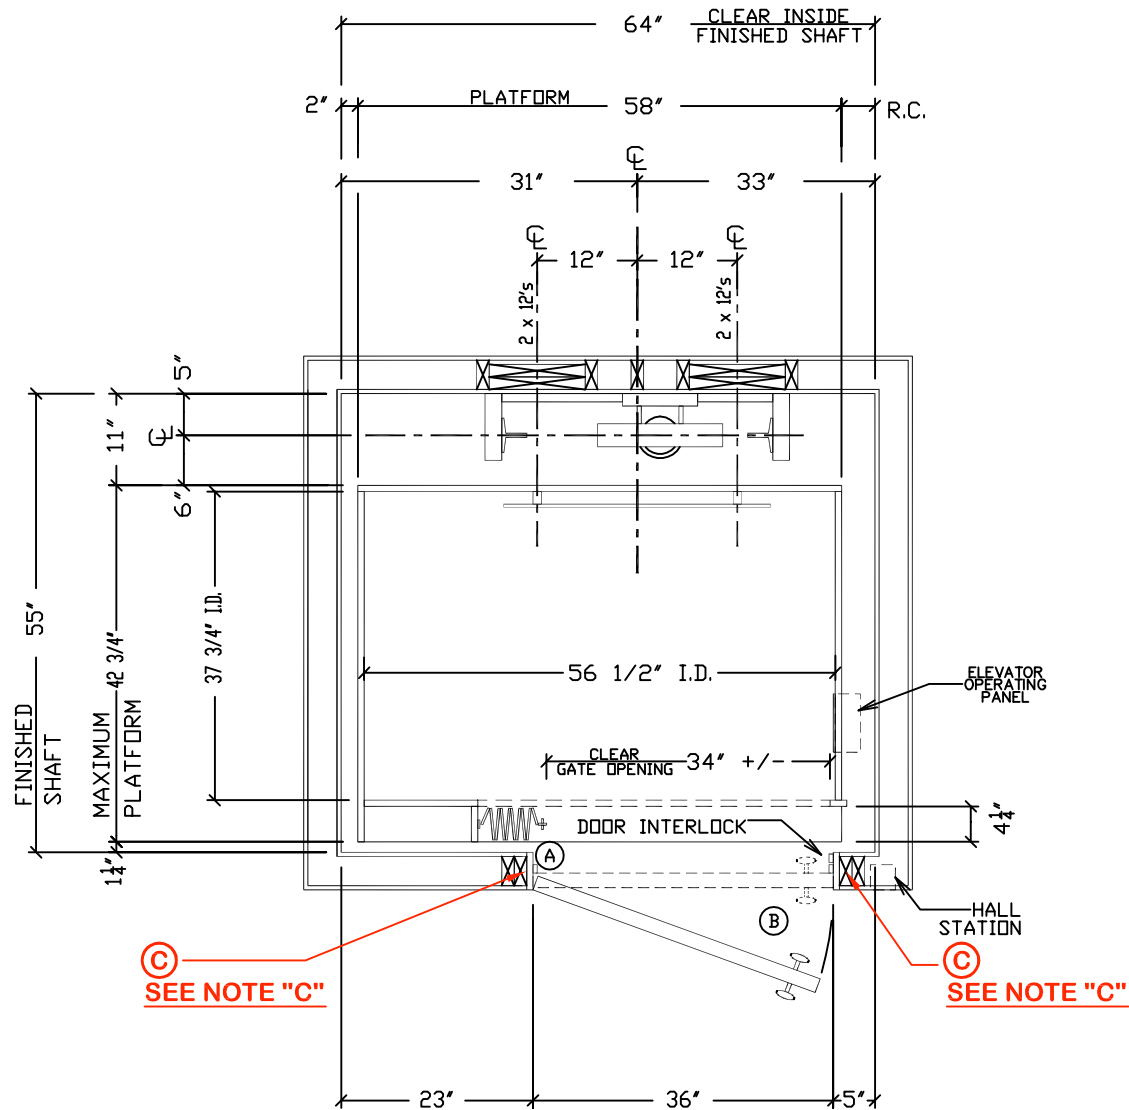

**HOISTWAY PLAN VIEW**

SCALE - NOT TO SCALE

NOTE: ALL DIMENSIONS ARE APPROXIMATE

| DRAWING/ REVISION(S) |          |          |             |
|----------------------|----------|----------|-------------|
| DRAWN:               | CHECKED: | DATE:    | DESCRIPTION |
| C.J.S.               | C.J.S.   | 03/01/09 | NEW DRAWING |
|                      |          |          |             |
|                      |          |          |             |