


JOB NAME: RIGHT RAIL, PASS THROUGH APPLICATION	DRAWING NUMBER: WILTEK-4 12 SQ FT
--	---

**NOTES:**

- Ⓐ 1/4" THICK MAXIMUM TRIM TO BE INSTALLED ON BACKSIDE OF LANDING DOOR FRAMES
- Ⓑ LANDING DOORS TO BE SOLID CORE (BY OTHERS)
- Ⓒ ALL LANDING DOORS AND JAMB/FRAMES ARE TO BE INSTALLED IN A 2" X 4" WALL CONSTRUCTION (OR EQUIVALENT) OR RECESSED TO THE SHAFT SIDE OF THE WALL IN A LARGER WALL CONSTRUCTION. THIS IS MANDATORY TO COMPLY WITH THE 3" X 5" RULE, PER ANSI A17.1; PART 5.3 PRIVATE RESIDENCE ELEVATORS (RULE 5.3.1.4.2). IF CONSTRUCTION OF THE LANDING DOOR WALL(S) IS GREATER THAN 2" X 4" CONSTRUCTION CONSULT WITH ELEVATOR MANUFACTURER PRIOR TO FRAMING AND INSTALLATION OF DOOR JAMB/FRAMES.
- Ⓓ MINIMUM FINISHED SHAFT DEPTH TO BE NO LESS THAN 52". IF MINIMUM SHAFT DEPTH REQUIREMENT IS NOT MET; THEN, ONE GATE OR BOTH GATES MAY BE REQUIRED TO BE STACKED (POSITIONED) OPPOSITE OF THE RAIL BLOCKING WALL.

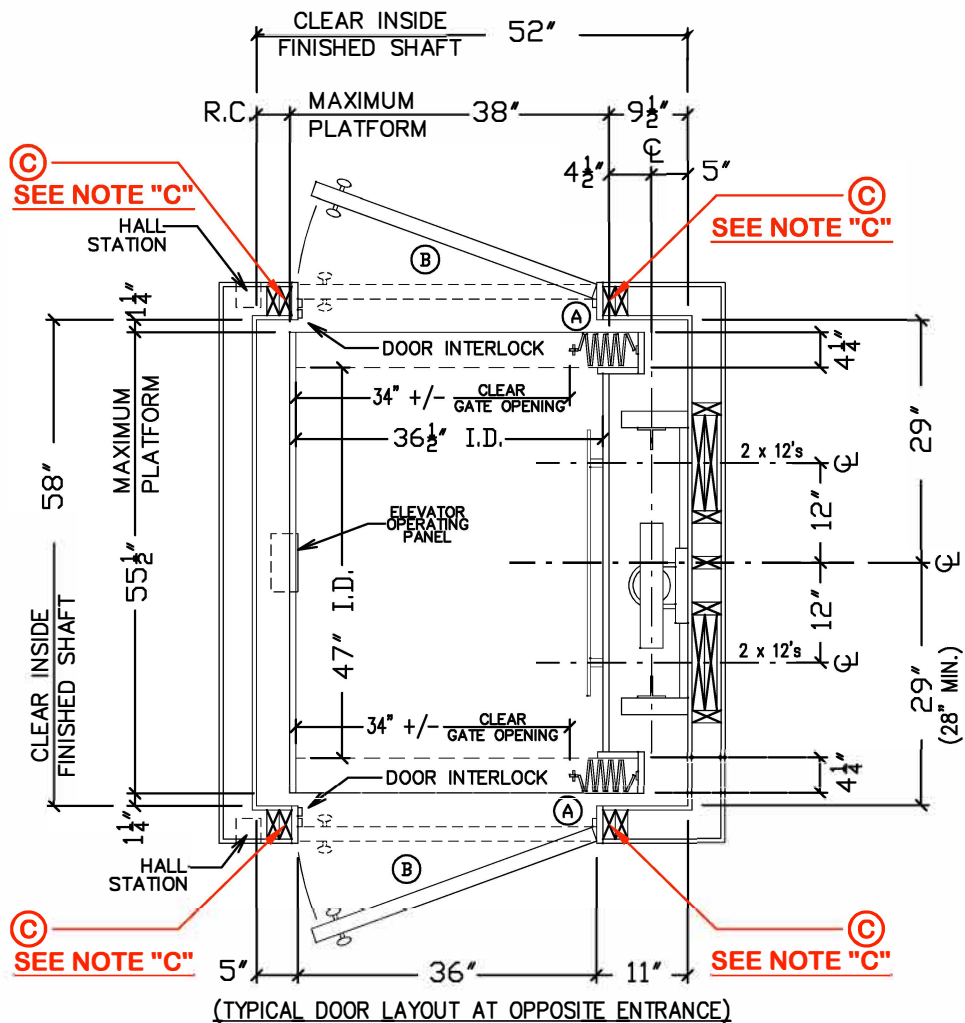

**HOISTWAY PLAN VIEW**

SCALE - NOT TO SCALE

NOTE: ALL DIMENSIONS ARE APPROXIMATE

DRAWING/ REVISION(S)

DRAWN:	CHECKED:	DATE:	DESCRIPTION
C.J.S.	C.J.S.	03/01/09	NEW DRAWING